


OVERHEAD AND IN VICINITY OF TRAM POLES



These are general guidelines for high risk zones in and around tram infrastructure. Please consult Bendigo Tramways for all works. Diagram not to scale. Energy Safe Victoria and Worksafe Victoria have jointly issued "[Guidebook - Using Powered Mobile Plant Near Overhead Assets](#)" that applies to works near Bendigo Tramways Assets. That document has precedence over this diagram.

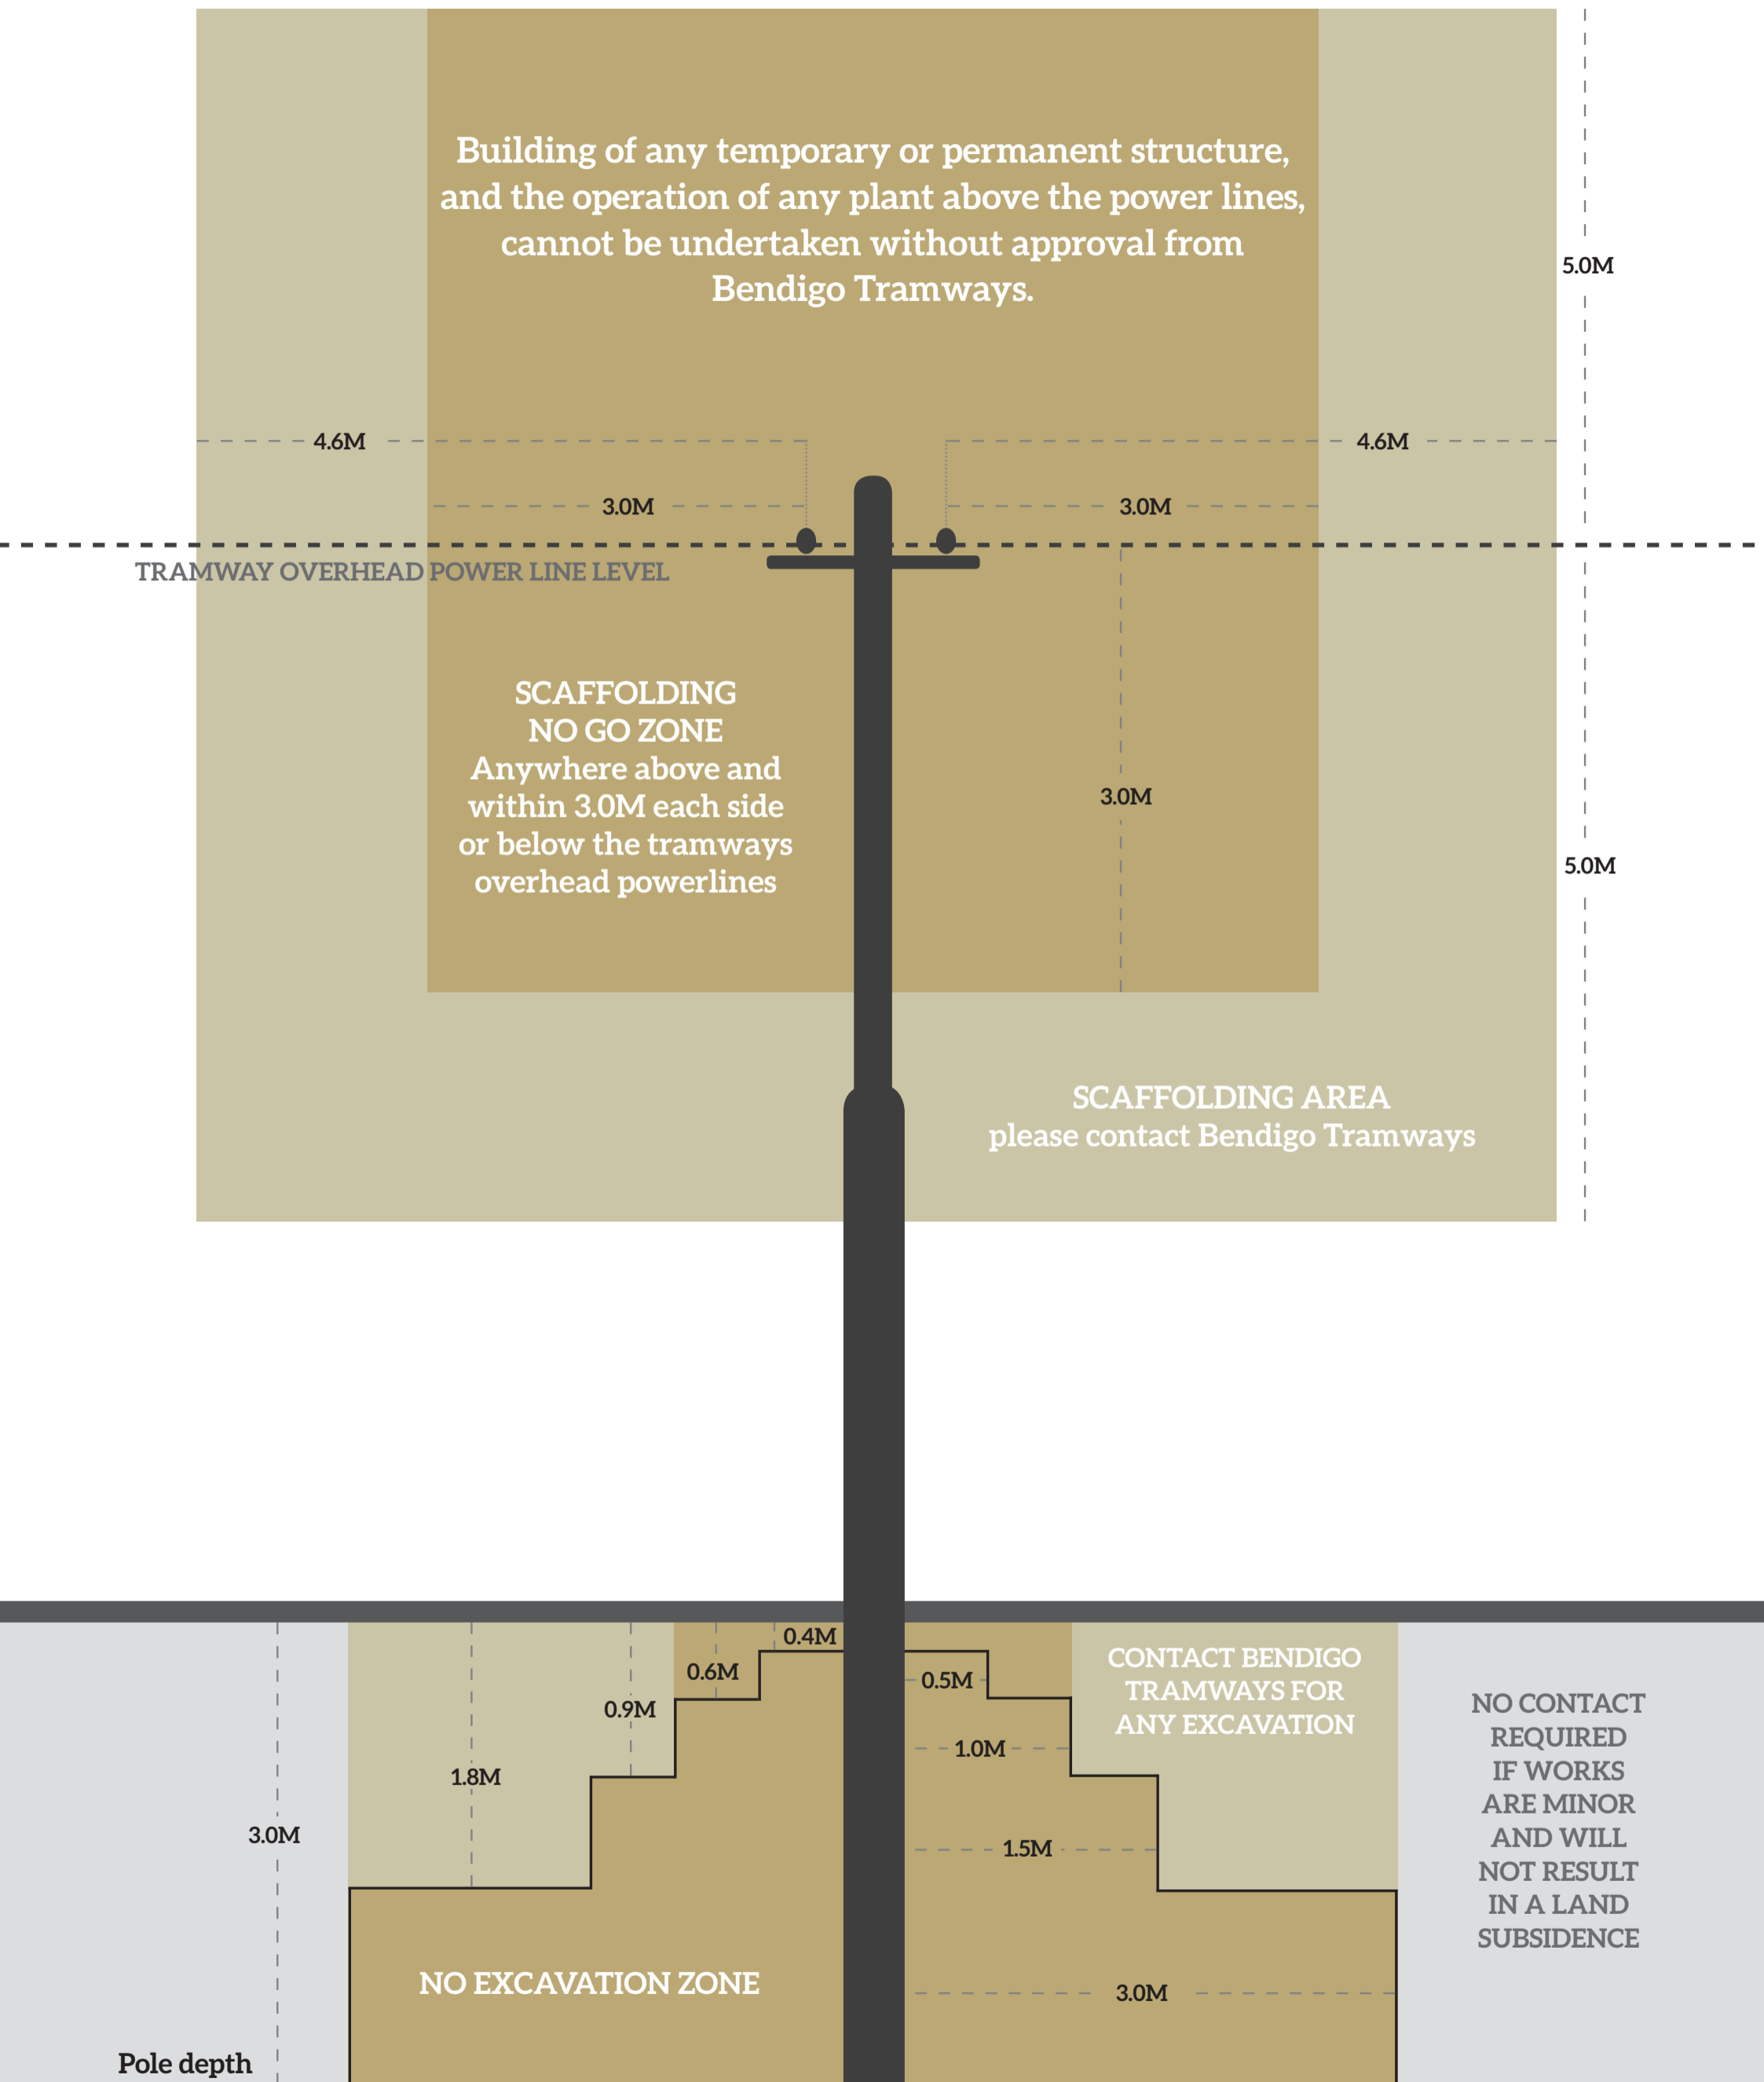